

**TX<sup>3</sup> RCCBs**  
**2P up to 80 A**

Cat. N°(s) : 4 119 10 , 4 119 11, 4 119 12, 4 119 13, 4 119 14,  
4 119 22, 4 119 23, 4 119 24, 4 119 25, 4 119 26, 4 119 27,  
4 119 28




CONTENTS	PAGE
1. Description, use.....	1
2. Range .....	1
3. Overall dimensions.....	1
4. Preparation - Connection.....	1
5. General characteristics.....	4
6. Compliance and approvals .....	9
7. Curves.....	10
8. Auxiliaries and accessories .....	11
9. Safety.....	11

**1. DESCRIPTION - USE**

Residual current circuit breaker (RCCB) with positive contact indication for control, protection and isolation of electrical circuits, protecting people from direct and indirect contact and protecting installations from insulation faults.

**Symbol:**



**Technology:**

. Electromagnetic residual current function with current-sensing relay

**2. RANGE**

**Polarity:**

. 2 pole

**Width:**

. 2 modules (2 x 17.8 mm)

**Nominal rating I<sub>n</sub>:**

. 16 / 25 / 40 / 63 / 80 A

**Residual current types:**

- . A (residual currents with a DC component)
- . A-S (discriminating)

**Sensitivity:**

. 10 / 30 / 300 mA

**Nominal voltage and frequency:**


. 230 V~ / 240 V~, 50 Hz with standard tolerances

**Maximum operating voltage:**


. 250 V ~, 50 Hz

**3. OVERALL DIMENSIONS**

**. Without sealable screw cover:**

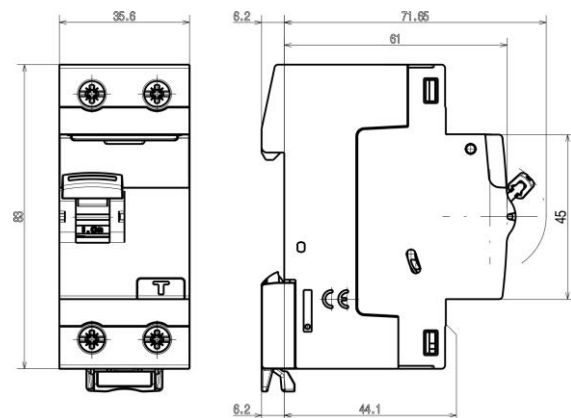

**. With sealable screw cover:**

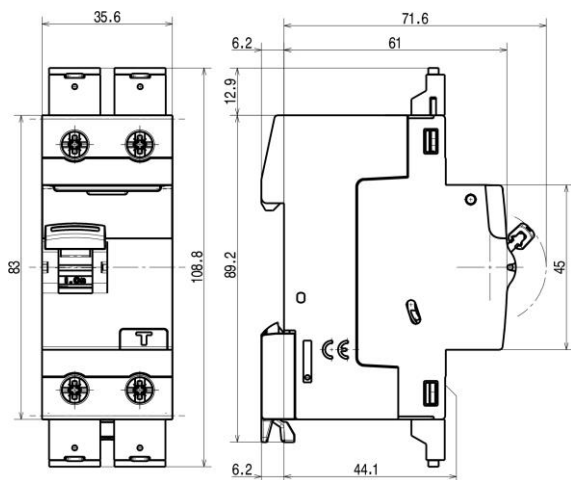

# TX<sup>3</sup> RCCBs

## 2P up to 80 A


Cat. N°(s) : 4 119 10 , 4 119 11, 4 119 12, 4 119 13, 4 119 14,  
4 119 22, 4 119 23, 4 119 24, 4 119 25, 4 119 26, 4 119 27,  
4 119 28

### 4. PREPARATION - CONNECTION

#### Mounting:

- On symmetrical rail EN 60715 or DIN 35 rail

#### Operating positions:

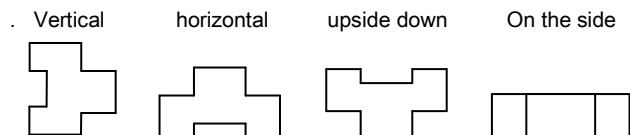

#### Power supply:

- From the top or the bottom

#### Connection:

- Inputs and outputs via screw terminals
- Cage terminals, with disengageable and captive screws.

#### Accessories:

Delivered with 4 sealable screw cover, for the upstream or downstream terminals.



#### Terminal arrangement:


- Terminals protected against direct finger contact IP20, wired device
- Alignment and spacing of the terminals permitting shutters with the other products in the range via fork supply busbars.
- Terminal depth: 14 mm
- Terminal capacity: 60 mm<sup>2</sup>
- Screw head: mixed head, slotted head and Philips / Pozidriv no. 2
- Tightening torques:
  - Minimum / Maximum: 1.2 Nm / 3.5 Nm
  - Recommended: 2.5 Nm

### 4. PREPARATION - CONNECTION (continued)


- A RCCB may be replaced in the middle of a row supplied with fork busbars without disconnecting the other products

Unscrew the terminals completely


Put the clamp in the unlocking position with a screwdriver

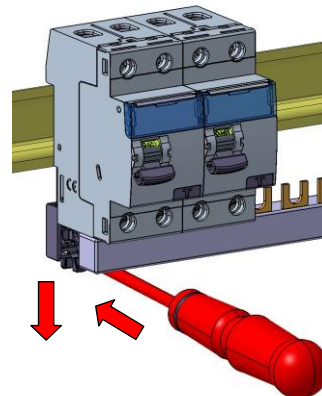

Pull the device downward in order to release it completely from the prongs of the busbar. Then pull the device forward

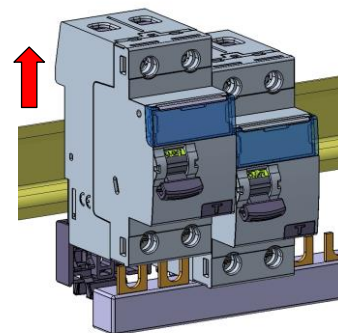

Pull the device upward

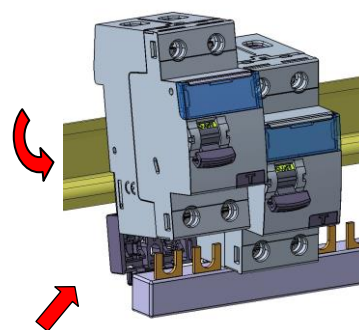

# TX<sup>3</sup> RCCBs

## 2P up to 80 A

Cat. N°(s) : 4 119 10 , 4 119 11, 4 119 12, 4 119 13, 4 119 14,  
4 119 22, 4 119 23, 4 119 24, 4 119 25, 4 119 26, 4 119 27,  
4 119 28

### 4. PREPARATION - CONNECTION *(continued)*

#### Conductor types:

- . Copper cables at the top and bottom of the product
  - Cable cross-section:

	Without ferrule	With ferrule
Rigid cable	1 x 0.75 to 50 mm <sup>2</sup> or 2 x 0.75 to 16 mm <sup>2</sup>	/
Flexible cable	1 x 0.75 to 35 mm <sup>2</sup> or 2 x 0.75 to 16 mm <sup>2</sup>	1 x 0.75 to 25 mm <sup>2</sup>

#### Required tools:

- . For the terminals:
  - 5.5 mm / 6.5 mm blade screwdriver recommended
  - Pozidriv n°2 / Philips N°2 screwdriver recommended
- . For the latching:
  - 5.5 mm blade screwdriver recommended / 6 mm maximum
  - Pozidriv n°2 / Philips N°2 screwdriver recommended

#### Device handling:

- . Manual action via ergonomic 2 position handle:
  - I-On, device closed
  - O-Off, device open

#### Contact status display:

- . By marking of the handle:
  - I-On, in white on a red background: closed contacts
  - O-Off, in white on a green background: contacts open

#### Residual current trip display:

- . Handle at the bottom position, the residual current is released

#### Lockout:


- . Padlocks possible in the open or closed positions with padlock support (Cat. No. 4 063 03) and Ø5 mm padlock (Cat. No. 4 063 13) or Ø6 mm padlock (Cat. No. 227 97)

#### Sealing:

- . Possible in the open or closed positions, even with the screw cover

#### Labelling:

- . Circuit identification by way of a label inserted in the label holder situated on the front of the product

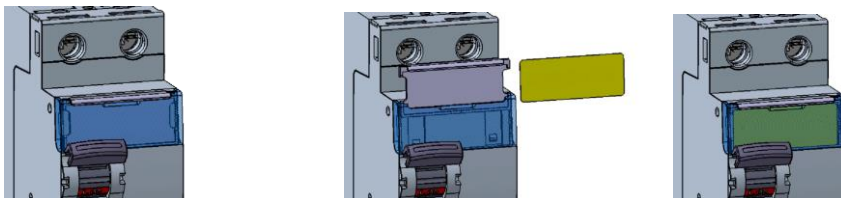

# TX<sup>3</sup> RCCBs 2P up to 80 A

Cat. N°(s) : 4 119 10 , 4 119 11, 4 119 12, 4 119 13, 4 119 14,  
4 119 22, 4 119 23, 4 119 24, 4 119 25, 4 119 26, 4 119 27,  
4 119 28


## 5. GENERAL CHARACTERISTICS

### Neutral earthing system:

. IT, TT and TN


### Marking:

. Marking on the "front side": (by permanent ink pad printing)

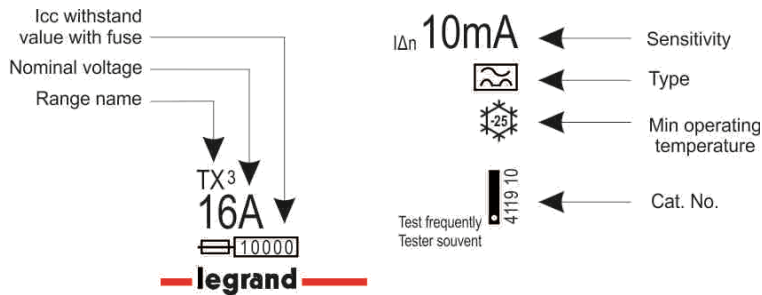

### Marking on the upper panel:

. By permanent ink pad printing

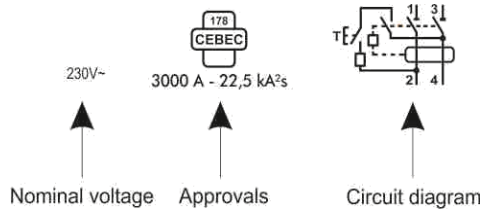

### Test operating voltage:

- . 10 mA, A type: from 110 V to 250 V~
- . 30 mA, A type: from 180 V to 250 V ~
- . 300 mA A types : from 110V to 250V
- . 300 mA A-S types : from 110V to 250V

### Rated conditional short-circuit current:

.  $I_{nc} = 10$  kA, in accordance with EN/IEC61008-1

### Rated conditional short-circuit residual current:

.  $I_{\Delta c} = 10$  kA, in accordance with EN/IEC61008-1

### Rated residual breaking capacity:

.  $I_{\Delta m} = 1000$  A, in accordance with EN/IEC61008-1

### Rated breaking and making capacity:

In accordance with EN/IEC61008-1,

- .  $I_n = 16 / 25 / 40$  A :  $I_m = 500$  A
- .  $I_n = 63$  A :  $I_m = 630$  A
- .  $I_n = 80$  A :  $I_m = 800$  A

# TX<sup>3</sup> RCCBs 2P up to 80 A

Cat. N°(s) : 4 119 10 , 4 119 11, 4 119 12, 4 119 13, 4 119 14,  
4 119 22, 4 119 23, 4 119 24, 4 119 25, 4 119 26, 4 119 27,  
4 119 28

## 5. GENERAL CHARACTERISTICS (continued)

### Specific use:

. Appropriate to operate in humid atmosphere and polluted by a chlorinated environment (pool-type)

### Protection against overloads:

. The RCCB must be protected against overloads (either upstream or downstream) by a circuit breaker or a fuse which has a maximum of the same nominal current as the residual current switch

### Protection against short-circuits:

. The RCCB must be protected upstream against short circuits using a circuit breaker or a fuse. Its resistance to short circuits when associated with a Legrand circuit breaker or fuse is compliant with the values stated in the tables below:

. Association with a fuse:

Downstream	Upstream			
TX <sup>3</sup> RCCB 2P	gG or aM type fuse			
Rating	≤ 50 A	63 A	80 A	≥ 100 A
16 A to 80 A	<b>100 kA</b>	<b>50 kA</b>	<b>15 kA</b>	<b>10 kA</b>

. Association with a circuit breaker:

Downstream TX <sup>3</sup> RCCB 2P	Curves	Upstream circuit breaker	
		TX <sup>3</sup> 3000 A	TX <sup>3</sup> 6000 A
2P - 230 V~	In	≤ 40 A	≤ 63 A
	16 A à 80 A	<b>- kA</b>	<b>10 kA</b>

Downstream TX <sup>3</sup> RCCB 2P	Curves	Upstream circuit breaker			
		DX <sup>3</sup> 4500 / 6 kA P+N 1 mod	DX <sup>3</sup> 4500 / 6 kA 3P / 4P 3 mod	DX <sup>3</sup> 6000 / 10 kA P+N 1 mod	DX <sup>3</sup> 6000 / 10 kA
2P - 230 V~	In	≤ 40 A	≤ 32 A	≤ 40 A	≤ 63 A
	16 A à 80 A	<b>6 kA</b>	<b>10 kA</b>	<b>10 kA</b>	<b>16 kA</b>

Downstream TX <sup>3</sup> RCCB 2P	Curves	Upstream circuit breaker				
		DX <sup>3</sup> 10000 / 16 kA P+N 1 mod	DX <sup>3</sup> 10000 / 16 kA	DX <sup>3</sup> 25 kA	DX <sup>3</sup> 36 kA	DX <sup>3</sup> 50 kA
2P - 230 V~	In	≤ 20 A	≤ 125 A	≤ 125 A	≤ 80 A	≤ 63 A
	16 A à 80 A	<b>16 kA</b>	<b>25 kA</b>	<b>36 kA</b>	<b>50 kA</b>	<b>70 kA</b>

# TX<sup>3</sup> RCCBs 2P up to 80 A

Cat. N°(s) : 4 119 10 , 4 119 11, 4 119 12, 4 119 13, 4 119 14,  
4 119 22, 4 119 23, 4 119 24, 4 119 25, 4 119 26, 4 119 27,  
4 119 28

## 5. GENERAL CHARACTERISTICS (continued)

### Protection against short circuits (continued):

		Upstream circuit breaker			
		DPX <sup>3</sup> 160 / DPX <sup>3</sup> 160 + residual current			
		16 kA	25 kA	36 kA	50 kA
Downstream TX <sup>3</sup> RCCB 2P	In	≤ 160 A	≤ 160 A	≤ 160 A	≤ 160 A
2P - 240 V~	16 A to 80 A	<b>25 kA</b>	<b>36 kA</b>	<b>36 kA</b>	<b>36 kA</b>

. Association with circuit breakers: case of a double fault, in IT system – Resistance to the Icc of a single pole

Downstream TX <sup>3</sup> RCCB 2P	Circuit breaker upstream	
	DX <sup>3</sup> 1P / 2P / 3P / 4P	
	10000 A	
At 240 V	<b>10 kA</b>	
At 415 V	<b>3 kA</b>	

Downstream TX <sup>3</sup> RCCB 2P	Circuit breaker upstream			
	DX <sup>3</sup> 1P / 2P / 3P / 4P	DX <sup>3</sup> 1P / 2P / 3P / 4P	DX <sup>3</sup> 1P / 2P / 3P / 4P	DX <sup>3</sup> 1P / 2P / 3P / 4P
	10000 A	25 kA	36 kA	36 kA
At 240 V	<b>16 kA</b>	<b>25 kA</b>	<b>36 kA</b>	<b>50 kA</b>
At 415 V	<b>4 kA</b>	<b>6,25 kA</b>	<b>9 kA</b>	<b>12,5 kA</b>

# TX<sup>3</sup> RCCBs

## 2P up to 80 A

Cat. N°(s) : 4 119 10 , 4 119 11, 4 119 12, 4 119 13, 4 119 14,  
4 119 22, 4 119 23, 4 119 24, 4 119 25, 4 119 26, 4 119 27,  
4 119 28

### 5. GENERAL CHARACTERISTICS *(continued)*

Power dissipated by the device:

TX <sup>3</sup> RCCB 2P		Power dissipated by the device (In)	
In	Sensitivity	A type	A-S type
16 A	10 mA	<b>0.8 W</b>	
25 A	30 mA	<b>1.5 W</b>	
40 A	30 mA	<b>4 W</b>	
40 A	300 mA	<b>1.3 W</b>	<b>1.1 W</b>
63 A	30 mA	<b>3.1 W</b>	
63 A	300 mA	<b>3.1 W</b>	<b>3 W</b>
80 A	30 mA	<b>5 W</b>	
80 A	300 mA	<b>5 W</b>	

#### Temperature derating:

. Reference temperature: 30°C in accordance with standard IEC 60947-2

In (A)	Ambient Temperature/In								
	- 25°C	- 10°C	0°C	10°C	20°C	30°C	40°C	50°C	60°C
16 A	<b>16</b>	<b>16</b>	<b>16</b>	<b>16</b>	<b>16</b>	16	<b>16</b>	<b>16</b>	<b>16</b>
25 A	<b>25</b>	<b>25</b>	<b>25</b>	<b>25</b>	<b>25</b>	25	<b>25</b>	<b>25</b>	<b>25</b>
40 A	<b>40</b>	<b>40</b>	<b>40</b>	<b>40</b>	<b>40</b>	40	<b>40</b>	<b>25</b>	<b>25</b>
63 A	<b>63</b>	<b>63</b>	<b>63</b>	<b>63</b>	<b>63</b>	63	<b>63</b>	<b>40</b>	<b>40</b>
80 A	<b>80</b>	<b>80</b>	<b>80</b>	<b>80</b>	<b>80</b>	80	<b>80</b>	<b>63</b>	<b>63</b>

# TX<sup>3</sup> RCCBs

## 2P up to 80 A

Cat. N°(s) : 4 119 10 , 4 119 11, 4 119 12, 4 119 13, 4 119 14,  
4 119 22, 4 119 23, 4 119 24, 4 119 25, 4 119 26, 4 119 27,  
4 119 28

### 5. GENERAL CHARACTERISTICS (continued)

#### Weight per device:

Cat number	Description	Weight (kg)
4 119 10	16 A A type 10 mA	0.19
4 119 11	25 A A type 30 mA	0.22
4 119 12	40 A A type 30 mA	0.22
4 119 22	40 A A type 300 mA	0.19
4 119 27	40 A AS type 300 mA	0.21
4 119 13	63 A A type 30 mA	0.22
4 119 23	63 A A type 300 mA	0.19
4 119 28	63 A AS type 300 mA	0.21
4 119 14	80 A A type 30 mA	0.21
4 119 24	80 A A type 300 mA	0.19

#### Packaged volume and quantity:

	Volume (dm <sup>3</sup> )	Packaging
For all catalogue numbers	0.35	per unit

#### Isolation distance: (distance between the contacts)

- Handle in open position - O-Off:
- Greater than 4.5 mm

#### Rated insulation voltage:

- U<sub>i</sub> = 250 V

#### Insulation resistance:

- 2 MΩ

#### Degree of pollution:

- 2

#### Dielectric strength:

- 2000 V - 50 Hz

#### Impulse withstand voltage:

- U<sub>imp</sub> = 4 kV

#### Protection from false tripping:

- 0.5 μs/100 kHz damped recurring wave = 200 A
- 8/20 μs wave:
  - A type = 250 A
  - A-S type = 3000 A

#### Protection classes:

- Terminals protected against direct contact:
  - IP20 (wired device)
- Front side protected against direct contact:
  - IP40
- Class II in relation to metallic conductive parts
- Protection against impacts:
  - IK04

### 5. GENERAL CHARACTERISTICS (continued)

#### Plastic materials used:

- Parts made of polyamide and P.B.T.

#### Device's upper heating value:

- Estimated heating value of a 25 or 40A 30mA AC device: 2.41 MJ

#### Electrical endurance:

- Conforms to standard EN/IEC 61008-1
- Tested with 10,000 operations with load (at  $I_n \times \cos \phi 0.9$ )
- Tested with 2,000 residual current trip operations using the test button or the fault current

#### Enclosure heat and fire resistance:

- Resistance to incandescent wire tests at 960°C, in accordance with standard EN/IEC 61008-1
- Classification V2, in accordance with standard UL94

#### Ambient temperature:

- Operating: - 25°C / + 60°C
- Storage: - 40°C / + 70°C

#### Derating of RCCBs function of the number of devices placed side by side:

When several RCCBs are installed side by side and operate simultaneously, the heat dissipation of one pole is limited. This results in an increased operating temperature for the RCCBs which may cause false tripping. Applying the following coefficients to the operating currents is recommended.

Number of circuit breakers side by side	Coefficient
2 - 3	0.9
4 - 5	0.8
6 - 9	0.7
≥ 10	0.6

These values are provided by recommendation IEC 60439-1.

In order to avoid having to use these coefficients there must be good ventilation and the devices must be kept apart using the spacing elements Cat. No. 4 063 07 (0.5 module).

#### Influence of the altitude:

	2,000 m	3,000 m	4,000 m	5,000 m
Dielectric strength	2,000 V	2,000 V	2,000 V	1,500 V
Maximum operating voltage	400 V	400 V	400 V	400 V
Derating at 30°C	none	none	none	none



# TX<sup>3</sup> RCCBs

## 2P up to 80 A

Cat. N°(s) : 4 119 10 , 4 119 11, 4 119 12, 4 119 13, 4 119 14,  
4 119 22, 4 119 23, 4 119 24, 4 119 25, 4 119 26, 4 119 27,  
4 119 28

### 5. GENERAL CHARACTERISTICS *(continued)*

#### DC operation:

- . Cannot be used with DC

#### Operation at 400 Hz:

- . Cannot be used at 400 Hz

#### Operation at 60 Hz:

- . Can be used at 60Hz, except ratings 63A/80A, A type, with sensitivity 30mA.

#### Handle opening and closing forces:

- . Force of 23 N for closing - (all ratings)
- . Force of 8 N for opening - (all ratings)

#### Mechanical endurance:

- . Conforms to standard BIS/IEC 61008-1
- . Tested with 20,000 operations with no load

#### Resistance to sinusoidal vibrations: (in accordance with IEC 68.2.6)

- . Axes: x / y / z
- . Frequency: 10 to 55 Hz
- . Acceleration: 3 g (1 g = 9.81 m.s<sup>-2</sup>)

#### Resistance to tremors :

- . Conforms to standard EN/IEC 61008-1

### 6. COMPLIANCE AND APPROVALS

#### In accordance with standards:

- . EN/IEC 61008-1
- . EN/IEC 60 529 (IP)

#### Approvals:

- . CEBEC + 3000A 22.5A<sup>2</sup>s

#### Environment respect – Compliance with EEC directives:

- . Compliance with European Union Directives
- . Compliance with Directive 2002/95/EC of 27/01/03 known as "RoHS" which provides for a restriction on the use of dangerous substances such as lead, mercury, cadmium, hexavalent chromium and polybrominated biphenyl (PBB) and polybrominated diphenyl ether (PBDE) brominated flame retardants from 1st July 2006
- . Compliance with the Directive 91/338/EEC of 18/06/91 and decree 94-647 of 27/07/94

#### Usage in special conditions:

- . Category C compliant (testing temperature of -25°C to +70°C, resistant to salt spray) in accordance with the classification defined in Appendix Q of standard IEC 60947-1

#### Plastic materials:

- . Zero halogen plastic materials.
- . Labelling compliant with ISO 11469 and ISO 1043.

#### Packaging:


- . Design and manufacture of packaging compliant with decree 98-638 of 20/07/98 and Directive 94/62/EC

**7. CURVES**

**Tripping current curves:**

. Tripping time curve depending on the value of the fault current:

**TYPE**

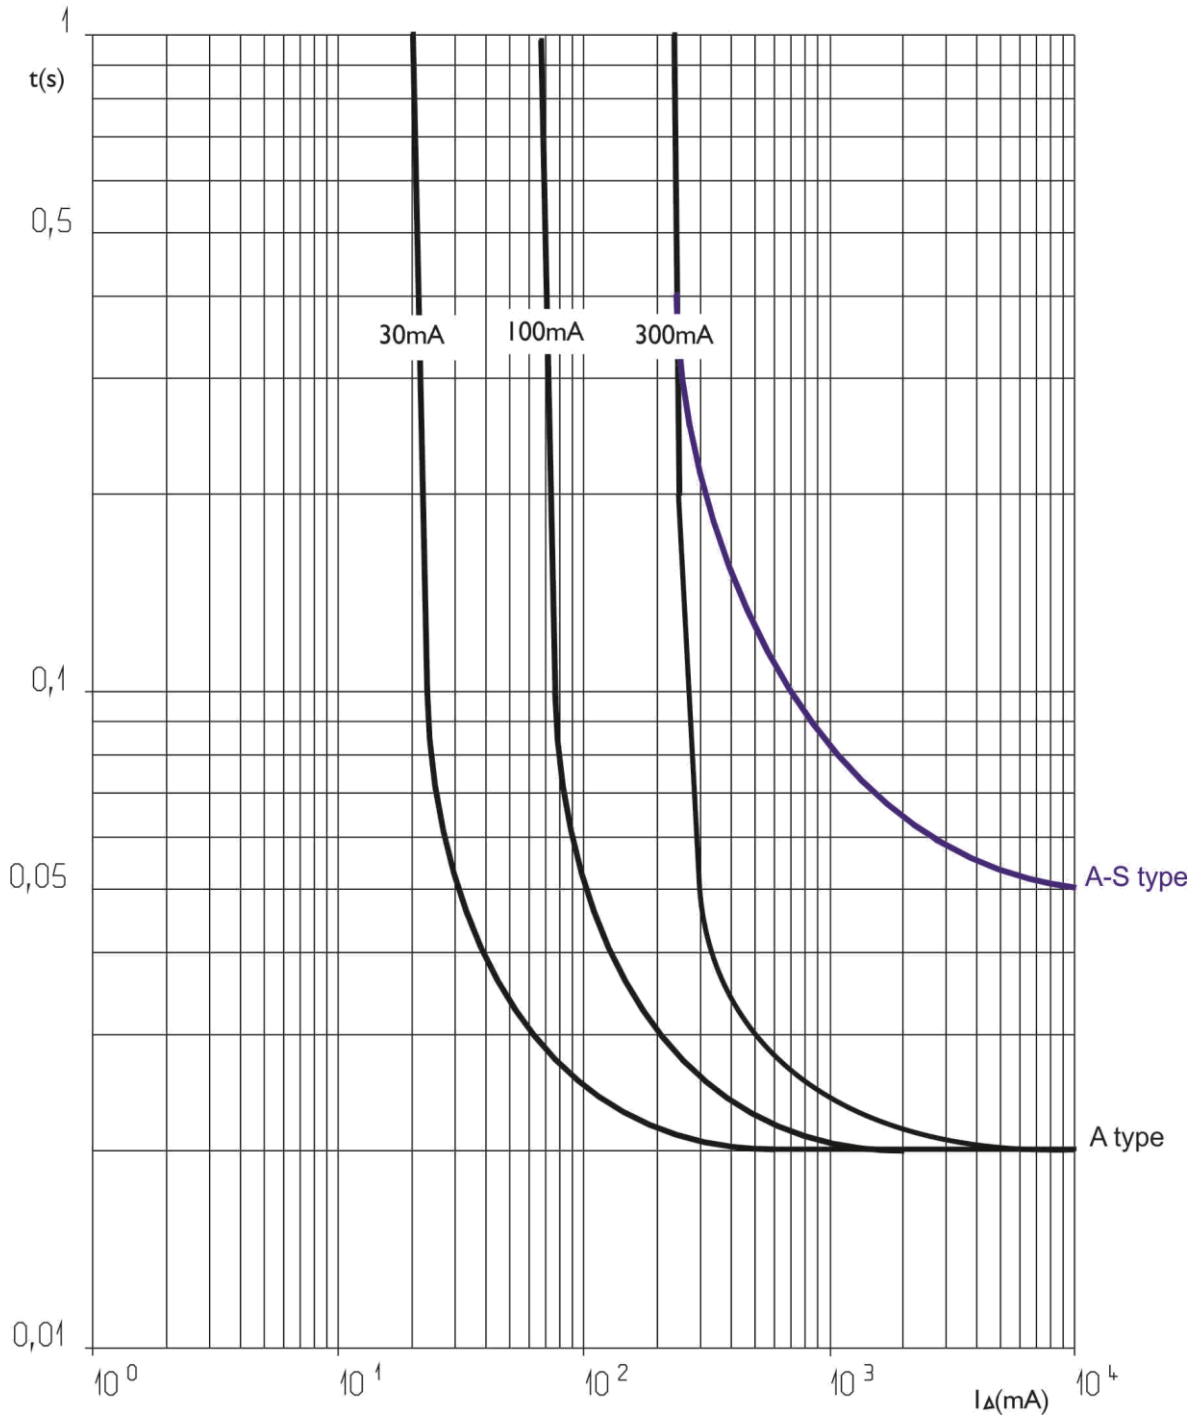

## 8. AUXILIARIES AND ACCESSORIES

### Wiring accessories:

- . Fork busbar
- . Pin busbar HX<sup>3</sup> traditional.
- . Sealable screw cover (cat n° 4 063 04).
- . Insulating shields (cat n° 4 063 05)
- . Dispatcher row Lexiclic
- . Dispatcher row HX<sup>3</sup>

### Signalling auxiliaries - fork busbar adapted:

- . Auxiliary contact (½ module – cat n° 4 062 50).
- . Fault signalling changeover switch (½ module – cat n° 4 062 52).
- . Auxiliary contact modifiable in default signal (½ module – cat n° 4 062 56).
- . Auxiliary contact + fault signalling switch - can be modified to 2 auxiliary contacts (1 module - cat n° 4 062 64)

### Signalling auxiliaries - prong busbar adapted:

- . Auxiliary contact (½ module – cat n° 4 062 58).
- . Fault signalling changeover switch (½ module – cat n° 4 062 60).
- . Auxiliary contact modifiable in default signal (½ module – cat n° 4 062 62).
- . Auxiliary contact + fault signalling switch - can be modified to 2 auxiliary contacts (1 module - cat n° 4 062 66).

### Control auxiliaries:

- . Shunt releases (1 module - cat n° 4 062 76 /78)
- . Under voltage release (1 module - cat n° 4 062 80 /82)
- . Autonomous shunt trip for NC push-button (1 module - cat n° 4 062 84).
- . Power Overvoltage Protection (1 module – cat n° 4 062 86)

### Motor driven control modules

- . Motor driven control module (1 module – cat n° 4 062 91)
- . Motor driven control module with automatic resetting integrated (2 modules – cat n° 4 062 93 /95)

### Front external rotary handle

- . Black handle (cat nat n° 4 063 19)
- . Yellow and red handle (cat n° 4 063 20)

### Possible combinations of rccb and auxiliaries:

- . Auxiliaries are clipped on the left of the rccb
- . Maximum number of auxiliaries for one circuit-breaker: 3.
- . Two signalling auxiliaries max. (cat. n° 4 062 58 /60 /62 /66).
- . Only one control auxiliary (cat. n° 4 062 76 /78 /80 /82 / 84).
- . One remote control or Stop & Go motor driven remote control
- . If signalling and control auxiliaries are associated on the same circuit breaker, the command auxiliary must be placed to the left of the signal auxiliary

### Installation software:

- . XL PRO<sup>3</sup>

## 9. SAFETY

- . For your safety your electrical installation is equipped with residual current protection and this must be tested periodically. In the absence of any national regulations on the time period required for this, Legrand recommends that this test be carried out every month: press the "T" test button, the device should trip. Please call an electrician immediately if this does not happen as your installation's safety level has been reduced
- . The presence of residual current protection does not remove the need to observe all the precautions associated with using electrical energy